

ASTM E 90 SOUND TRANSMISSION LOSS TEST REPORT

Rendered to:

VELUX AMERICA INC.

SERIES/MODEL: FCM 4646 0004

TYPE: Fixed Curb Mounted Skylight

Summary of Test Results			
Data File No.	Glazing(Nominal Dimensions)	STC	OITC
B0237.01	23/32" IG (5/32" tempered exterior, 11/32" argon, 7/32" laminated interior), Glass temperature 75°F	33	28

Reference should be made to Architectural Testing, Inc. Report No. B0237.01-113-11 for complete test specimen description. The complete test results are listed in Appendix B.

ATI No.

B0237.01


Date

06/10/11

Specimen Area Filler Area 1.69 Square Meters
11.30 Square Meters

Operator

Daniel P. Platts

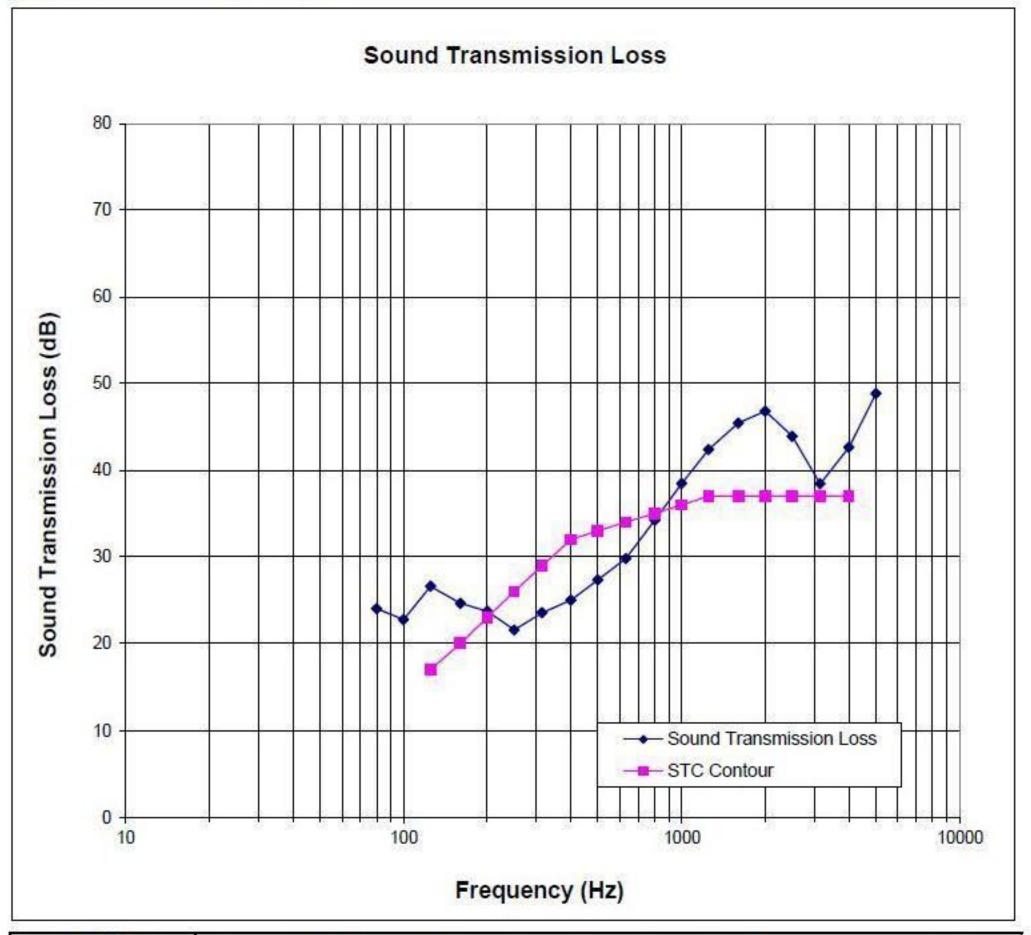



Architectural Testing, Inc. is accredited by the International Accreditation Service, Inc. (IAS) under the specific test methods listed under lab code TL-144, in accordance with the recognized International Standard ISO/IEC 17025:2005. The laboratory's accreditation or test report in no way constitutes or implies product certification, approval, or endorsement by IAS. This test report applies only to the specimen that was tested.